

4



3

2

1

B

B

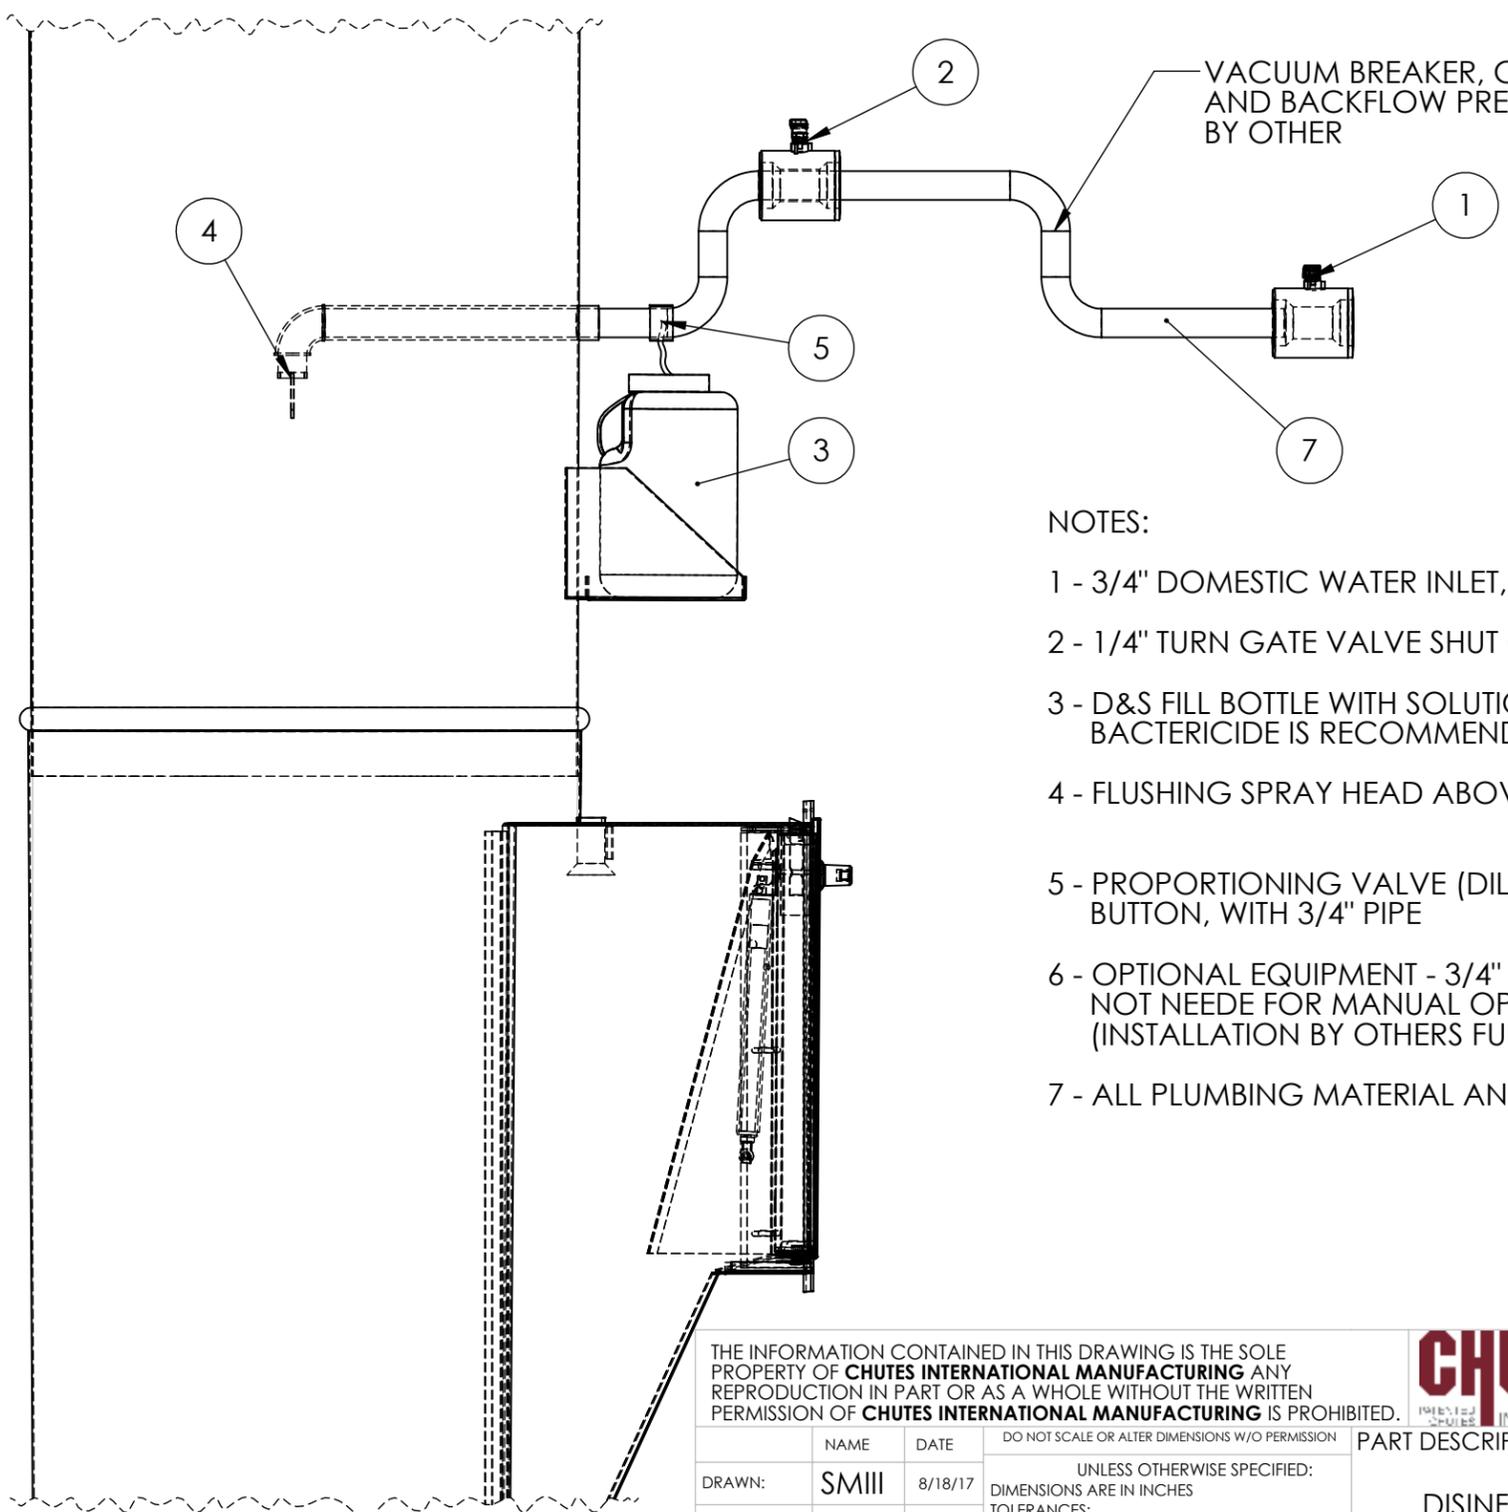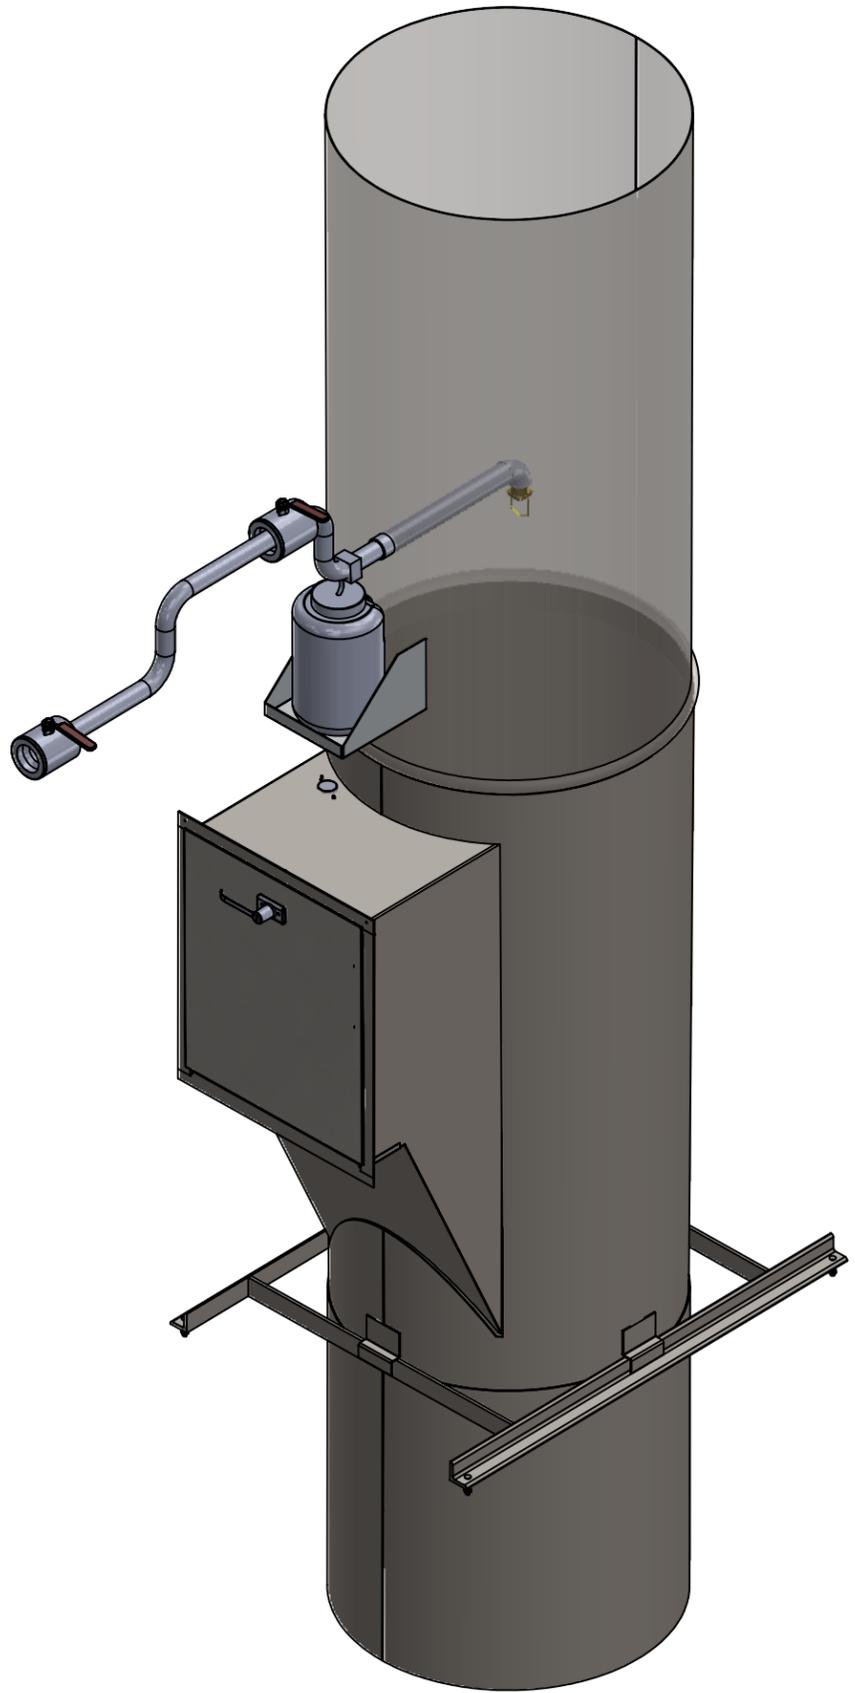

NOTES:

- 1 - 3/4" DOMESTIC WATER INLET, (BY OTHERS)
- 2 - 1/4" TURN GATE VALVE SHUT OFF AND BY-PASS (BY OTHERS)
- 3 - D&S FILL BOTTLE WITH SOLUTION (USE OF A BIODEGRADABLE BACTERICIDE IS RECOMMENDED).
- 4 - FLUSHING SPRAY HEAD ABOVE HIGHEST INTAKE.
- 5 - PROPORTIONING VALVE (DILUTES SOLUTION) & BY-PASS BUTTON, WITH 3/4" PIPE
- 6 - OPTIONAL EQUIPMENT - 3/4" ELECTRIC SOLENOID VALVE NOT NEEDED FOR MANUAL OPERATION. (INSTALLATION BY OTHERS FURNISH ONLY. NOT SHOWN.)
- 7 - ALL PLUMBING MATERIAL AND LABOR SUPPLIED BY OTHERS.

A

A

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF **CHUTES INTERNATIONAL MANUFACTURING** ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF **CHUTES INTERNATIONAL MANUFACTURING** IS PROHIBITED.

CHUTES INTERNATIONAL 33 Industrial Park Dr.
Waldorf, MD 20602
240-448-5000

NAME	DATE	DO NOT SCALE OR ALTER DIMENSIONS W/O PERMISSION
DRAWN: SMIII	8/18/17	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES TOLERANCES: GENERAL FRACTIONAL: MAX+1/8 FOR ASSEMBLY BENDING MAX:+0.03125 BEND ANGLE: ±1° BEND-LINE PLACEMENT: ±0.0625 PUNCHING: ±0.005 WELDING: ADD 0.1250 PER WELD PATH
CHECKED BY:		
COMMENTS:		
MATERIAL:		

PART DESCRIPTION: DISINFECTING & SANITIZING UNIT		
SIZE B	PART NAME:	REV
SCALE:	WEIGHT:	SHEET 1 OF 1

4

3

2

1